

EcoNordic WH4

ART.NO.: 800501



Flexit EcoNordic WH4 is an indoor climate central with integrated functions for balanced ventilation, tap water production and heating for homes. The unit provides a healthy indoor climate, plenty of hot tapwater and heating in a very energy efficient way. If little domestic heating is required, the energy is taken directly from the tank without starting the heat pump. The unit is built up from 4 modules to simplify handling and installation.

- Environmental friendly/natural refrigerant CO₂.
- Very high efficiency through heat recovery in both ventilation module and heat pump.
- Rotary heat exchanger for optimal operation in Nordic climate.
- Compressor operation with good efficiency down to -25°C.
- Energy efficient hotwater production to 65°C through compressor only.
- All components placed indoor, no need for outdoor unit.
- Low installed power.
- All-in-one. Balanced ventilation, hot water and water-borne heating for homes.
- Offers the opportunity for considerable redistribution (TEK17).
- If little domestic heating is required, the energy is taken directly from the tank without starting the heat pump.

Automatic control

All functions of the climate heat pump are easily controlled via the Flexit GO app.



Art.no.	GTIN	Model
800501	7023678005019	EcoNordic WH4

Technical data

		400 V 3N~	230 V 3~
PERFORMANCE	Tap water profile (EN 16147)	XL	XL
	COP, tap water (EN 16147)	3,21	3,21
	Outgoing compressor capacity	up to 4 kW	up to 4 kW
	Sound output (EN12102-2)	52 dB(A)	52 dB(A)
	IP class	IP21	IP21
	Maximum air flow	370 m³/h @ 100 Pa	370 m³/h @ 100 Pa
		103 l/s @ 100 Pa	103 l/s @ 100 Pa
	SFP range (l,5)	110 - 319 m³/h @ 100 Pa	110 - 319 m³/h @ 100 Pa
		31 - 88 l/s @ 100 Pa	31 - 88 l/s @ 100 Pa
	Temperature efficiency	> 90 %	> 90 %
	SCOP (EN 14825)	3,22	3,22
POWER	Rated voltage	400 V 3N~	230 V 3~
	Instantaneous water heater output	3 kW (1 kW)	3 kW (1 kW)
	Fuse size	3×16 A (3×10 A)	3×25 A (3×16 A)
	Rated current, total	14,3 A (10,0 A)	22,3 A (14,8 A)
	Rated power, total	6,4 kW (4,4 kW)	6,4 kW (4,4 kW)
VENTILATION	Fan type	B-wheel	B-wheel
	Fan motor control	0-10 V	0-10 V
	Automatic control standard	Flexit GO	Flexit GO
	Filter type (supply air/extract air)	ePM1 55 % (F7)	ePM1 55 % (F7)
	Duct connection	Ø 160 mm	Ø 160 mm
HOT WATER	Tank volume	197 L	197 L
	Nominal operating pressure	0,45/4,5 MPa/bar	0,45/4,5 MPa/bar
	Max operating pressure	0,7/7 MPa/bar	0,7/7 MPa/bar
	Temperature, hot water	5 - 65 °C (Legionella: 75 °C)	5 - 65 °C (Legionella: 75 °C)
HEAT PUMP	Coolant medium	CO ₂ (0,5 kg)	CO ₂ (0,5 kg)
	GWP	1	1
	Duct connection	Ø 200 mm	Ø 200 mm
	Max operating pressure	14/140 MPa/bar	14/140 MPa/bar
	Outdoor air temperature	Min. -25 °C	Min. -25 °C
	Inverter control	Yes	Yes
DIMENSIONS	Height	1900 mm	1900 mm
	Width	1198 mm	1198 mm
	Depth	650 mm	650 mm
WEIGHT	Total excluding water	220 kg	220 kg
	Tank module	64 kg 58,5 kg (weight without door)	64 kg 58,5 kg (weight without door)
	Ventilation module	79 kg 70,5 kg (weight without door)	79 kg 70,5 kg (weight without door)
	Heat pump	65 kg 59 kg (weight without door)	65 kg 59 kg (weight without door)
	Ventilation chassis	12 kg	12 kg
INSTALLATION	Position	Technical room/cupboard	Technical room/cupboard
	Room temperature	Min. 3 °C	Min. 3 °C



Energy class:




(average climatic conditions)

Capacity diagram

Supply air side

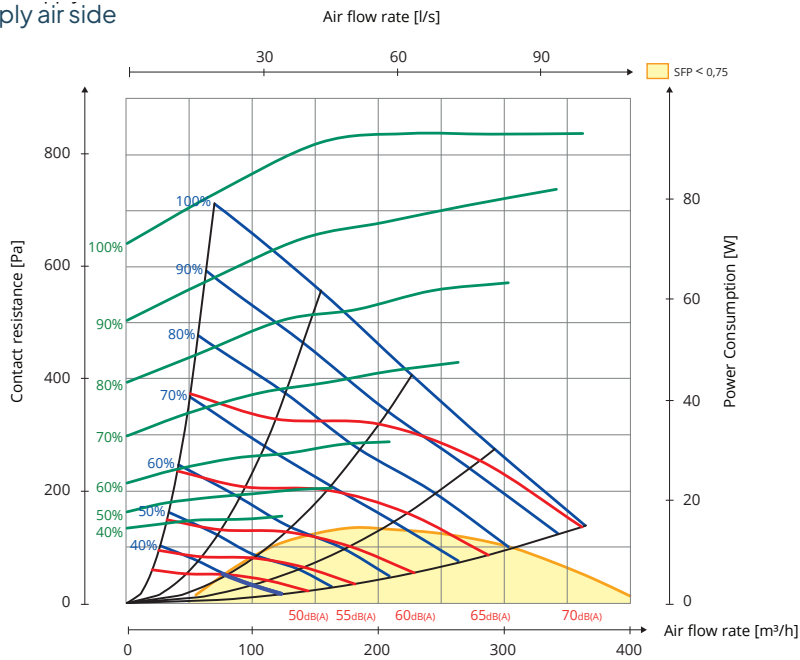

Extract air side

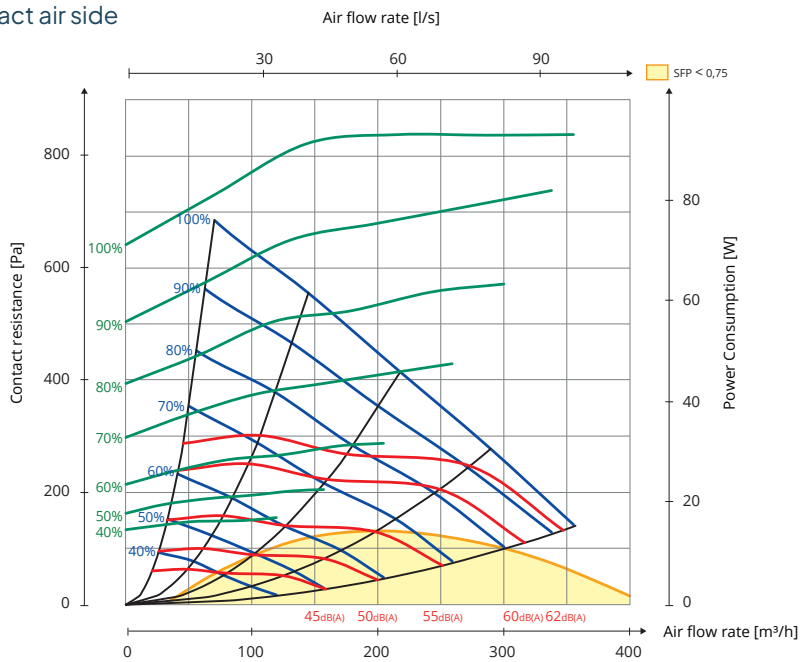

Hz	63 Lw(dB)	125 Lw(dB)	250 Lw(dB)	500 Lw(dB)	1000 Lw(dB)	2000 Lw(dB)	4000 Lw(dB)	8000 Lw(dB)	LwA (dBA)
Supply air	7	7	3	-2	-14	-12	-18	-29	
Extract air	13	10	1	-2	-17	-20	-30	-32	
Radiated	-11	-8	-12	0	0	0	-36	-34	-15

Explanation of diagram:

Sound data is specified as sound power level LwA in the capacity diagrams. (This is sound to duct.)

These values can be corrected by means of the table for the different octave bands in order to look at Lw (without adaptation to A band).

The correction table for the various octaves is stated in Lw, which means that the Lw values are after conversion of each octave for supply air and extract air.

Radiated sound from the unit must be calculated from the supply air diagram.

